



# Operating Manual

**Cabinet Cooler &  
Cabinet Cooler System**



# Contents

Section	Page
1. Introduction	5
2. Safety and Inspection	6
3. Maintenance	7
4. Compressed Air Supply	9
5. Compressed Air Line Sizes	10
6. Installation	13
7. Operation	18
8. Solenoid Valve and Thermostat (Cabinet Cooler System Only)	20
9. Approvals	22
10. Troubleshooting	23

Products shown in this document may be covered by one or more patents, patents applied for and/or registered designs and/or trade marks. For further information please refer to our Head Office or visit [www.meech.com](http://www.meech.com).



# 1. Introduction



The Meech Air Technology Stainless Steel Cabinet Cooler uses compressed air to provide a cold air source which stops industrial cabinet/panels or enclosures overheating and prevents ingress of contamination such as dust or moisture.

The Cabinet Cooler Unit (excluding Solenoid Valve and Thermostat) is intrinsically safe, and requires virtually no maintenance. They have no moving parts making them ideal for harsh environments.

Cabinet Coolers can be used with or without electrical thermostats and solenoid valves (Cabinet Cooler System). These are used to regulate the cooling within an enclosure.

This operating manual covers the following products. 'XX' in the product code represents 03 (stainless steel 303) or 16 (stainless steel 316).

- A70025-SS3XX – Cabinet Cooler Control Unit
- A70325-SS3XX-24V – Cabinet Cooler System 24V
- A70325-SS3XX-240V – Cabinet Cooler System 240V
- A70325-SS3XX-110V – Cabinet Cooler System 110V

## 2. Safety and Inspection

Meech Cabinet Coolers are packed carefully at our factory. Nevertheless, we recommend careful examination of the carton and contents for any damage.

To protect yourself and others when using compressed air, you should be aware of the following general safety guidelines:

- Warning – When compressed air is misused, it can cause serious injury or even death.
- Never point an air hose at anyone in fun or to remove dirt from clothing or the body.
- Never use compressed air without adequate eye and ear protection. Use safety glasses with side shields or goggles and ear protectors.
- Before attempting to disconnect a hose from an air line, the air should be cut off, and the remaining air bled from the line.
- Keep air hoses off the floor where they become tripping hazards and are subject to damage by vehicles, doors, and dropped tools. If possible, suspend air hoses from overhead.

Please be aware of the following safety guidelines specific to the Cabinet Cooler:

- Cabinet Coolers create both hot and cold air so parts of the unit will become hot.
- Do not operate the Cabinet Cooler at compressed air pressures above 11 Bar (160 psi)
- Compressed air temperature must not exceed 55°C
- Ambient operating temperature must not exceed 66°C

Ambient operating temperature can not drop lower than -10°C



### 3. Maintenance

The Meech Cabinet Cooler has no moving parts. Clean compressed air moving through the Cabinet Cooler will not cause wear on any of the components.

Occasionally, dirt, water or oil may enter the cooler from the compressed air supply. This could hinder the performance. If this happens simply take the unit apart, clean the parts with soapy water, allow drying time and then reassemble.

When reassembling ensure you tighten all the components. If the parts are not tightened correctly, the coolers performance may be affected. Also, please ensure the generator is fitted. At the same time the element in the air filter should be changed.

PRODUCT CODE	MATERIAL
A70025-SS303	303 STAINLESS STEEL
A70025-SS316	316 STAINLESS STEEL

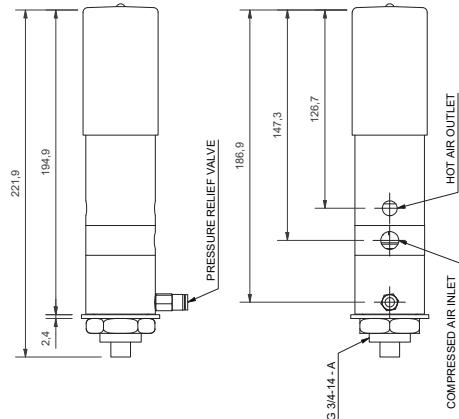

**Meech**  


TITLE: CABINET COOLER RISER AND BUMPER SPECIFIED		SHEET: 1/1		CHANGE NOTE: NA		MODEL REVISON NO: 1	
DRAWING NO: A70025-SSXXXX		DRAWN BY: J.M.BAILEY		CHECKED BY: M.BAILEY		DRAWN IN: MECH STATIC ELIMINATORS LTD	
VERSION: 1.0		PROJECTION: CIRCULAR TO SECTION (C)		DIMENSIONS IN: INCHES AS DRAWN		DIMENSIONS IN: MILLIMETERS AS DRAWN	
MATERIAL: VARIOUS		SIGNED OFF BY: DBH		DATE: 01/10/2014		DRAWING SECTION: A	
FINISH: 5		3		1		1	

**COPYRIGHT © MEECH STATIC ELIMINATORS LTD**  
 THIS DOCUMENT AND THE INFORMATION CONTAINED THEREIN IS THE PROPERTY OF MEECH STATIC ELIMINATORS LTD.  
 IT IS NOT TO BE COPIED OR DISSEMINATED WITHOUT THE WRITTEN CONSENT OF MEECH STATIC ELIMINATORS LTD.  
 THE PROPERTY OF MEECH STATIC ELIMINATORS LTD.

## 4. Compressed Air Supply

It is recommended to use a 5-micron (or smaller) filter to remove water and dirt from the compressed air supply. A 5-micron filter will remove 99% of foreign material from the air supply; the use of an oil filter with an effective filtration of 0.01 ppm will remove the oil droplets for an even cleaner compressed air supply.

Failure to use a filter may cause clogging and freezing of the compressed air line and the components within the Cabinet Cooler.

When the temperature of the compressed air within the Cabinet Cooler reaches 0°C the water vapour in the air will start to freeze. This could potentially cause a problem with ice clogging the orifices of the Cabinet Cooler.

In this instance an air dryer must be used to lower the dew point and keep water vapour out of the air line. A dryer rated at -19°C will produce a dew point low enough to eliminate the water vapour freezing.

## 5. Compressed Air Lines Sizes

Figuring the correct pipe size for your compressed air system is an important task. Pipe that is sized too small can create big pressure losses and reduce operating efficiency.

Many people who plan the piping never consider the fittings or the future.

**FITTINGS:** Every pipe fitting creates a certain amount of increased frictional air loss that is equal to a specified length of pipe. Any turns in the pipe at fittings, ells, tees, and valves increase pressure drops even more.

**FUTURE:** Are you planning to add more equipment in the next year or two? Then plan for larger piping now. Since the material costs in piping are low compared to installation or replacement cost, it's wise to select pipe of an adequate size. If there is any doubt that a pipe size may create a pressure drop, use the next largest size. Remember that an oversize pipe compensates for possible scale build-up and provides for future expansion of the overall air system.

### Steps to calculating overall piping size for your compressed air system:

1. Determine your air compressor's maximum CFM.
2. Draw a piping schematic and show all pipe fittings, valves, etc.
3. Measure and write the corresponding lengths of pipe on your schematic, then total the length of all straight pipes needed and note that on your schematic.
4. Using TABLE 1 (over page), find your compressor's CFM number on the far left column, and then go to the right until you see the column header with nearest length in feet to your total pipe length. Find where the CFM & PIPE LENGTH intersect on the chart and it will show the recommended pipe size for that length.

5. Take that pipe size to TABLE 2 and use the table to find all the EQUIVELENT LENGTHS OF PIPE needed for each PIPE FITTING. Write these lengths on your piping schematic at each fitting.
6. TOTAL all the EQUIVELENT LENGTHS OF PIPE needed for each PIPE FITTING and add to your total of straight length of pipe. This will give you a new and more accurate total pipe length needed.
7. Take your new total of EQUIVELENT LENGTH OF PIPE IN FEET back to TABLE 1 and use this number to determine the PIPE SIZE you need.

## Specific Cabinet Cooler Pipe Size

To obtain maximum performance from the Cabinet Cooler, accurate measures of air pressure and air volume must be obtained. Line pressure of 70-90 psi (5-6 Bar) can be present without a sufficient volume (cfm) of air.

To ensure that both pressure and volume are present to efficiently operate the Cabinet Cooler a line size of 3/8" pipe or 1/2" hose should be used for applications 10ft from the main header. Use 1/2" pipe or 3/4" hose up to 20ft. For pipe size over 20ft from the header please refer to section 5.


## How to determine what size of PIPE you need for compressed air lines:

Your Air Compressor's CFM	TABLE 1: EQUIVALENT LENGTH OF PIPE LINES IN FEET <i>Don't forget to include *PIPE FITTINGS in your final calculations</i>							
	25 feet	50 feet	75 feet	100 feet	150 feet	200 feet	250 feet	300 feet
1	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
2	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
3	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
5	1/2	1/2	1/2	1/2	1/2	1/2	1/2	1/2
10	1/2	1/2	1/2	3/4	3/4	3/4	3/4	3/4
15	1/2	3/4	3/4	3/4	3/4	3/4	3/4	3/4
20	3/4	3/4	3/4	3/4	3/4	3/4	3/4	3/4
25	3/4	3/4	3/4	3/4	3/4	1	1	1
30	3/4	3/4	3/4	3/4	1	1	1	1
35	3/4	3/4	1	1	1	1	1	1
40	3/4	1	1	1	1	1	1	1
50	1	1	1	1	1	1	1	1
60	1	1	1	1	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4
70	1	1	1	1	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4
80	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2
100	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2
125	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2
150	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/4	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2
175	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2	2	2	2	2
200	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2	2	2	2	2
225	1 - 1/2	1 - 1/2	1 - 1/2	1 - 1/2	2	2	2	2
250	2	2	2	2	2	2	2	2
275	2	2	2	2	2	2	2 - 1/2	2 - 1/2
300	2	2	2	2	2	2	2 - 1/2	2 - 1/2
350	2	2	2	2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2
400	2	2	2	2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2
450	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	3	3
500	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	3	3
550	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	3	3	3	3
600	2 - 1/2	2 - 1/2	2 - 1/2	2 - 1/2	3	3	3	3
750	2 - 1/2	2 - 1/2	2 - 1/2	3	3	3	3	4
1000	3	3	3	3	3	3	4	4

TABLE 2: * EQUIVALENT LENGTH OF PIPE (FT.) for PIPE FITTINGS <i>Add these numbers for each pipe fitting to total length of straight pipe</i>						
Pipe Size	Long Rad, Ell or run of tee	STD. Ell or Run of reduced tee	Tee Thru side outlet	Globe Valve	Gate Valve	
1/2	0.62	1.55	3.1	17.3	0.36	
3/4	0.82	2.06	4.12	22.9	0.48	
1	1.05	2.62	5.24	29.1	0.61	
1 - 1/4	1.38	3.45	6.9	38.3	0.81	
1 - 1/2	1.61	4.02	8.04	44.7	0.94	
2	2.07	5.17	10.3	57.4	1.21	
2 - 1/2	2.47	6.16	12.3	68.5	1.44	
3	3.07	6.16	15.3	85.2	1.79	
4	4.03	7.67	20.2	112	2.35	

## 6. Installation

The drawing below shows the recommended way to fit a Meech Cabinet Cooler and Cabinet Cooler System (including digital thermostat and solenoid valve).

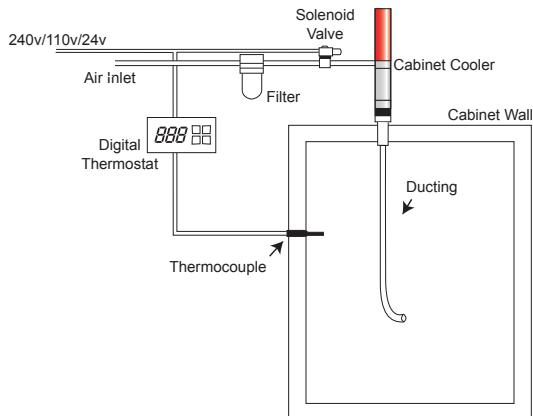

To fit the Cabinet Cooler follow the steps below:

### A. Drill Hole

Drill 1.02" (26 mm) hole in the position you would like to fit the Cabinet Cooler.

Please be aware that 200mm of the Cabinet Cooler will extend from the outside of the enclosure so allow clearance.

It's recommended that the Cabinet Cooler is installed in the top of the enclosure.

However, if space is an issue the Cabinet Cooler can be installed in any position, even upside down, with no loss of performance.



## B. Remove bulk head from the bottom of the Cabinet Cooler



## C. Fit desired generator

As standard the Cabinet Cooler is supplied with a red (Refrig) 15cfm, 293W (1000 Btu/hr) generator. To change the generator simply unscrew the bulk head fitting and replace the generator with another colour. Please remember to re-fit the o-ring and screw bulk head fitting until tight.

Four generators are provided with the Meech Cabinet Cooler. Information on all generators and sizing can be found in section 7.



## D. Fit Cabinet Cooler in place

From outside the enclosure, place the cold end of the Cabinet Cooler into the drilled hole.



## E. Re-fit bulk head nut and washer

Once this is done tighten bulk head nut & washer until the Cabinet Cooler is secure.



## F. Connect cold air ducting to the end.

It's recommended that the cold air ducting is directed from the cabinet cooler to the bottom of the enclosure. This will allow for increased cooling throughout the cabinet/panel. This will also avoid any excess water vapour in the compressed air being blown over components.

If the air is clean and dry the cold air ducting can be directed to particularly hot areas of the enclosure. Alternatively you can drill holes in the cold air ducting and allow air to be distributed to several areas. If you choose this method you will need to plug the end of the cold air ducting and ensure the holes drilled into the tube are equal to the hole at the end.

Where necessary please fit appropriate filters.



## G. Connect air supply

The Cabinet Cooler has a  $\frac{1}{4}$ " bsp female air inlet. Standard pneumatic push-fit compressed air fittings can be used on the Cabinet Cooler.

Please refer to section 5 when deciding on pipe sizes.



## H. Connect the digital thermostat & solenoid valve to the air supply (only with Cabinet Cooler System)

See section 8 of this operating manual

Your Cabinet Cooler is now ready for use.

# 7. Operation

## 1. Cabinet Cooler

The Cabinet Cooler is factory set to deliver the most efficient cooling needed to maintain a desired temperature inside an enclosure.

At 80psi (5.5 Bar), 10cfm (70% of 15 cfm, red generator) of cold air will exit from the Cabinet Cooler providing 293 Watts (1,000 Btu) of Cooling.

The bladder valve acts as a pressure relief valve. This will automatically release air from the enclosure between 1.5 & 3kPa (0.015 and 0.03 bar) dependent on the inlet air pressure.

This one-way bladder valve protects the Cabinet Cooler from dust and water ingress giving it the IP66 rating.

## 2. Generators

The generators within the Cabinet Cooler control the air consumption and air flow. They also influence the achievable temperatures.


The chart below shows achievable temperatures with different generators fitted.

Please note these are approximate temperatures and should only be used as a guide.

The Cabinet Cooler will perform differently when used in other environments.

Product Code	Generator Colour	Consumption in CFM (l/min)	Inlet air pressure					
			60 PSI (4.1 Bar)		80 PSI (5.5 Bar)		100 PSI (6.8 Bar)	
			CFM at test	2.5 turns of needle valve	CFM at test	2.5 turns of needle valve	CFM at test	2.5 turns of needle valve
A21008	Green	8L (227)	15 (425)	-23.4	19 (538)	-30.1	21 (595)	-33.4
A20008	Yellow	8H (227)	13 (368)	-24.2	18 (510)	-28.5	20 (566)	-31.7
A21010	Green	10L (283)	15 (425)	-26.9	19 (538)	-35.5	21 (595)	-36.0
A20010	Yellow	10H (283)	13 (368)	-27.2	18 (510)	-35.0	21 (595)	-31.3
A21015	White	15L (425)	17 (481)	-29.8	22 (623)	-34.2	25 (708)	-35.4
A20015	Red	15H (425)	16 (453)	-28.3	21 (595)	-32.9	25 (708)	-32.6
A21025	Grey	25L (708)	23 (651)	-23.3	28 (793)	-23.7	30 (849)	-25.7
A20025	Blue	25H (708)	23 (651)	-19.0	30 (849)	-23.4	31 (878)	-24.9
A21035	Beige	35L (991)	27 (765)	-16.7	34 (963)	-16.5	39 (1104)	-18.6
A20035	Brown	35H (991)	30 (849)	-15.8	36 (1019)	-18.6	43 (1218)	-18.0

The graph below shows air consumption at varying inlet air pressures.

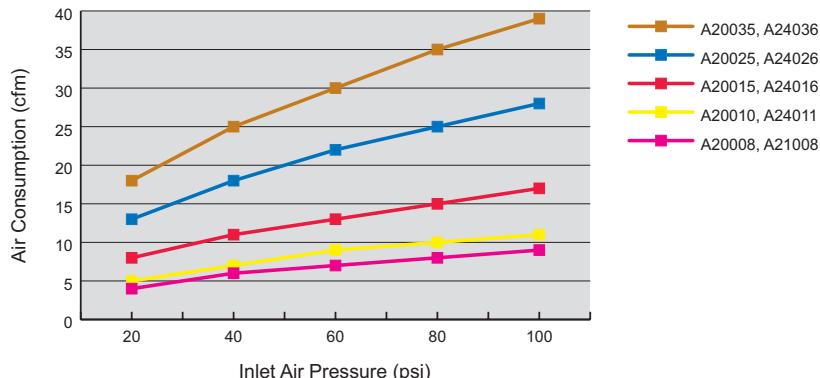

4 x High fraction generators are supplied as standard:

Yellow 10cfm (283 l/min) - Cooling capacity of 190W (650 Btu/hr)

Red 15cfm (425 l/min) – Cooling capacity of 293W (1000 Btu/hr)

Blue 25cfm (708 l/min) – Cooling capacity of 499W (1,700 Btu/hr)

Brown 35cfm (991 l/min) – Cooling capacity of 703W (2,400 Btu/hr)

A single Meech Cabinet Cooler is capable of cooling up to 703 Watts (2,400 Btu/hr). Optimising the cooling capacity is still a vitally important factor, choosing the correct generator will not only reduce running costs but also extend the life of the compressor.

To choose the most efficient generator you must calculate the total heat load in Watts Btu/hr to which the enclosure is exposed. The total heat load is a combination of the heat transfer from outside due to ambient air temperature and the heat which is created internally.

For more information on calculating test loads refer to the Meech Air Technology brochure, available to download from [www.meech.com](http://www.meech.com).

### 3. Humidity

If a cabinet cooler is run constantly relative humidity inside the cabinet stabilises at approximately 45%.

To prevent condensation forming on the cold air pipe close off any vents or fan outlets on the outside wall of the enclosure. This reduces the ambient air from circulating within the cabinet/panel and reduces the chance of condensation.

Fans can be installed into the enclosure which will help to circulate air.

## 8. Solenoid Valve & Thermostat (Cabinet Cooler System Only)

A Cabinet Cooler System is supplied with either a 24V, 110V or 240V digital thermostat and solenoid valve.

The combination of solenoid valve and digital thermostat allows application specific set up and reduces running costs. It means cold air will only be supplied to the enclosure when it's needed.

The digital thermostat is factory set to activate the cabinet cooler when the internal cabinet/panel temperature reaches 30°C. It will then cool the enclosure until the temperature drops to 22°C. At this point the Cabinet Cooler is deactivated ready for the process to start again.

### Adjustment of Meech Factory settings

The thermostat is password protected to stop adjustment of the parameters. The following 3 steps explain how to unlock the thermostat for parameter adjustment.

1. Power up thermostat – the temperature will be displayed.
2. Press and hold the 'P' until a '0' is displayed (when 0 is displayed release the 'P' button)
3. Press and hold the  $\wedge$  button until the display shows 9000. Press 'P' once, you will now have access to change the parameters.


### Adjusting the main parameters

There are 2 main parameters that you may wish to adjust; the Set Point and Differential. The following 5 steps will guide you through this process.


1. Use the 2 arrow buttons to toggle through the parameters.
2. When you reach 'SP' on the display stop and press the 'P' button once. This allows you to adjust the set point of the thermostat between 10 and 50. The Set

Point is the temperature that once activated the system will cool the cabinet/panel to (factory set to 22°C).

3. Once you have entered your Set Point press the 'P' button once. This will activate the new setting and return you to the main toggle menu.
4. Using the 2 arrow buttons toggle through the parameters until you reach 'HSEt'.
5. When you have reached 'HSEt' press the 'P' button once. This allows you to adjust the differential of cooling. The differential is the number of degrees above the set point that the unit will cool from (factory set to 8°C above a set point of 22°C, meaning the unit will start cooling when the internal cabinet temperature reaches 30°C).

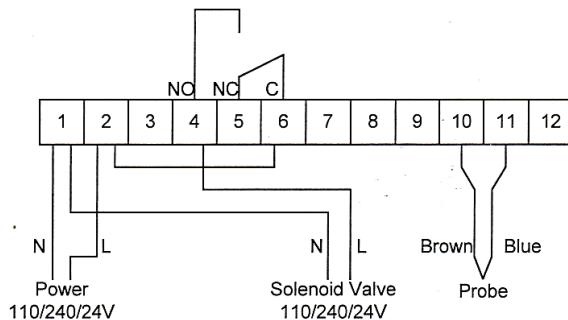

Thermostat Dimensions:

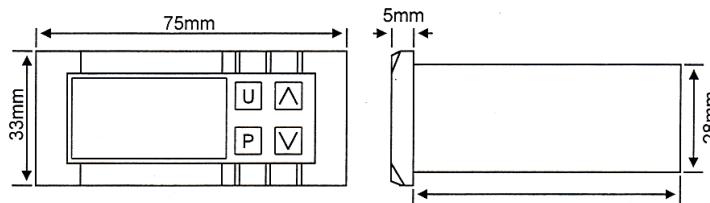

## 9. Approvals

The Meech Cabinet Cooler is IP66 (Nema 4X)

The Cabinet Cooler unit is issued in accordance with Directive 94/9/EC ("ATEX")

– Equipment and protective Systems Intended for use in Potentially Explosive Atmospheres

A Declaration of manufacture is available on request.

# 10. Troubleshooting

## Air flow

Problems with compressed air flow can be caused by:

1. Air pressure too low – increase air pressure at the relevant regulator
2. Undersized compressed air lines – replace pipes with correct sizes, see section 5
3. Blocked compressed air line – remove blockage
4. Insufficient compressor size – Check compressor size for fitting Cabinet Cooler

## Air Temperature

Problems with air temperature can be caused by:

1. Incorrect generator fitted – Check and replace generator, see section 7
2. Ambient compressed air temperature too high – Check compressed air temperature and use cooler if necessary
3. Loose/missing parts – Check all Cabinet Cooler parts are screwed in tightly and there are no missing parts.
4. Water vapour in the compressed air supply – Check compressed air supply
5. Air pressure too low – increase air pressure at the relevant regulator



**Meech International**  
2 Network Point  
Range Road, Witney  
OX29 0YN, UK

Tel: +44 (0)1993 706700  
Fax: +44 (0)1993 776977  
email: sales@meech.com

**Meech Static Eliminators (Shanghai) Co. Ltd**  
7G, 7F, LP Tower  
#25 Xiangfeng Road  
201103 Shanghai  
China

Tel: +86 400 820 0102  
Fax: +86 21 6405 7736  
email: china@meech.com

**Meech Static Eliminators USA Inc**  
1298 Centerview Circle  
Akron, OH 44321  
USA

Tel: +1 330 564 2000 / 1 800 232 4210  
Fax: +1 330 564 2005  
email: info@meech.com

**Meech Shavotech**  
29/2, Kharadi  
Off Pune-Nagar Road  
On Old Kharadi Mundhwa Road  
Pune : 411014 , Maharashtra  
India

Tel: +91 (0)703 093 8211 / +91 (0)741 000 4817  
Fax: +91 (080) 28395963  
email: india@meech.com

**Meech Elektrostatik SA**  
Kaiserbaracke 166  
B-4780 St.Vith  
Belgium

Tel: +49 (0)6555 3733 399  
+32 (0)80 670 204  
Fax: +32 (0)80 862 821  
email: mesa@meech.com

**Meech International (Singapore) Pte. Ltd.**  
7 Temasek Boulevard  
12 - 07 Suntec Tower One  
Singapore  
038987

Tel: +65 65918859  
email: singapore@meech.com

**Meech CE**  
Gábor László utca 2  
Budapest 1041  
Hungary

Tel: +36 1 7977039  
+36 30 2803334  
email: ce@meech.com